

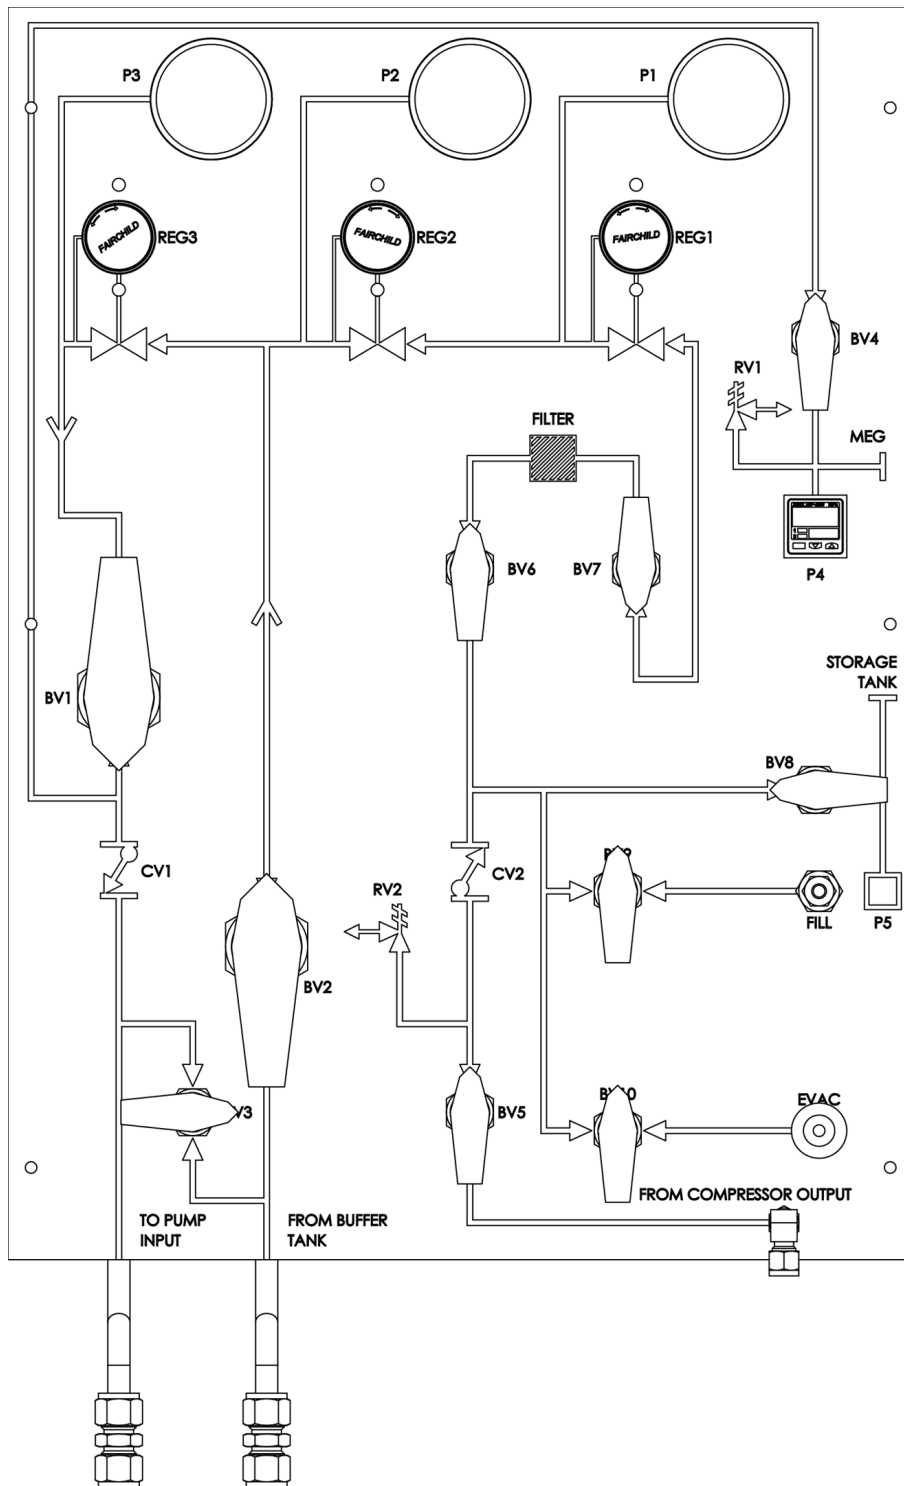


Figure 7.38 Layout of the pressure regulator panel during normal operation, with the buffer tank valves closed